

FRONT ELEVATION

REAR ELEVATION

SIDE ELEVATION


SECTION A-A

SUBSTATION DOORS TO MEET  
NORTHERN POWERGRID SPECIFICATION  
WITH 1810x2800mm HIGH BRICKWORK  
OPENING.


2m WIDE CLEAR ACCESS  
AROUND SUBSTATION FOR  
MAINTENANCE

NOTES

Substation doors to be set back a minimum of 1500mm  
from back edge of footpath. Any proposed reduction in this  
clearance to be approved by Northern Powergrid following  
submission of site specific risk assessment and operational  
method statement.

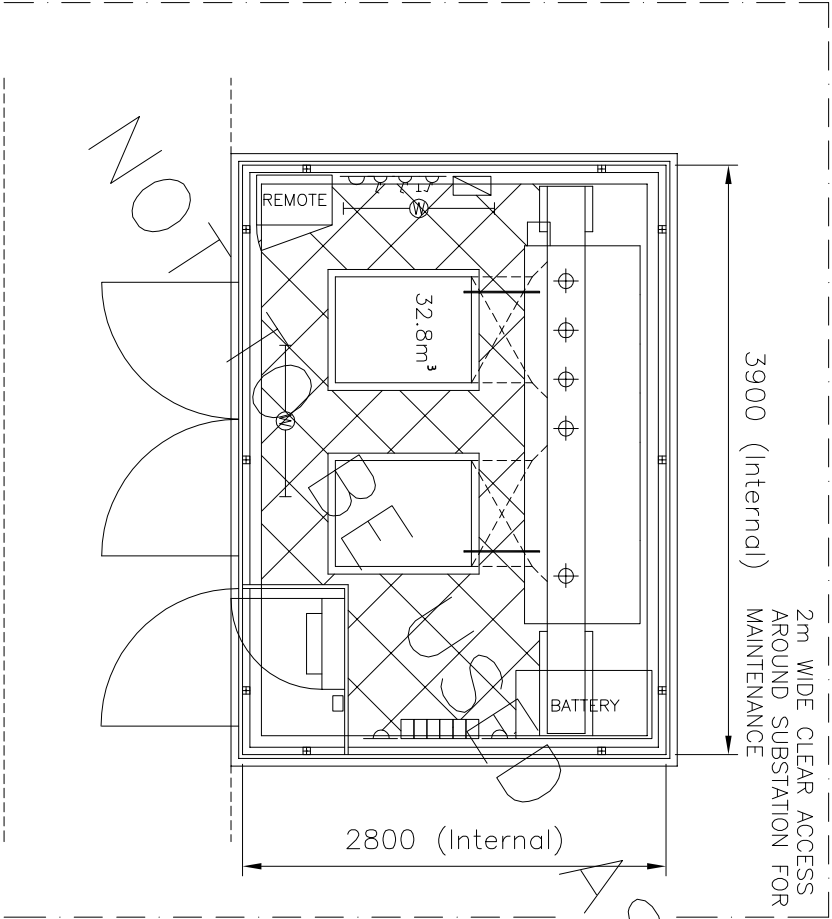

ELECTRICAL LAYOUT

		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		20kV EXTENSIBLE HV PANEL WITH METERING ANNEXE IN PREFABRICATED ENCLOSURE	
Sheet No.	1	Scale	AS SHOWN
Prepared By	TM	Grid Reference	Ref No.
Revised		Checked By	Revision
Date Issued	17.05.16		Notes