



ROOF TO HAVE EXPLOSION
RELIEF FITTINGS


EAVES VENTILATION
TO BE PROVIDED TO
3 SIDES (REAR & SIDES)

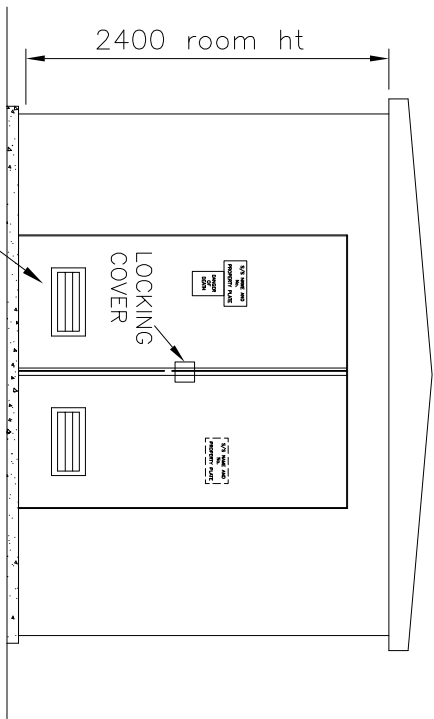


FRONT ELEVATION

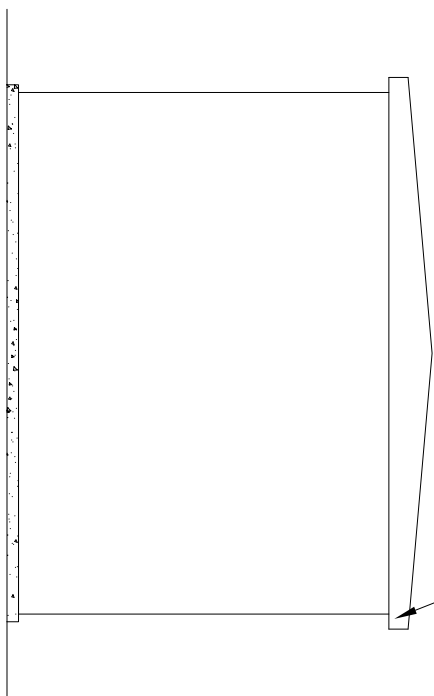

REAR ELEVATION

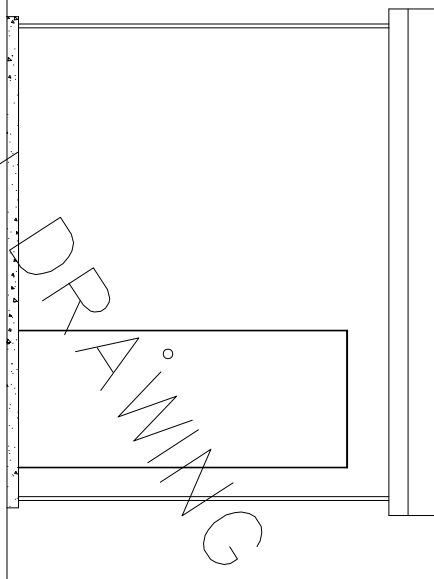


SIDE ELEVATION

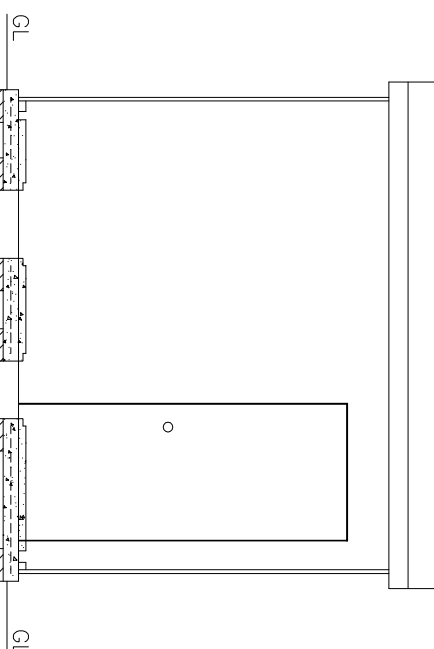


SECTION A-A

NOTES

Substation doors to be set back a minimum of 1500mm from back edge of footpath. Any proposed reduction in this clearance to be approved by Northern Powergrid following submission of site specific risk assessment and operational method statement.

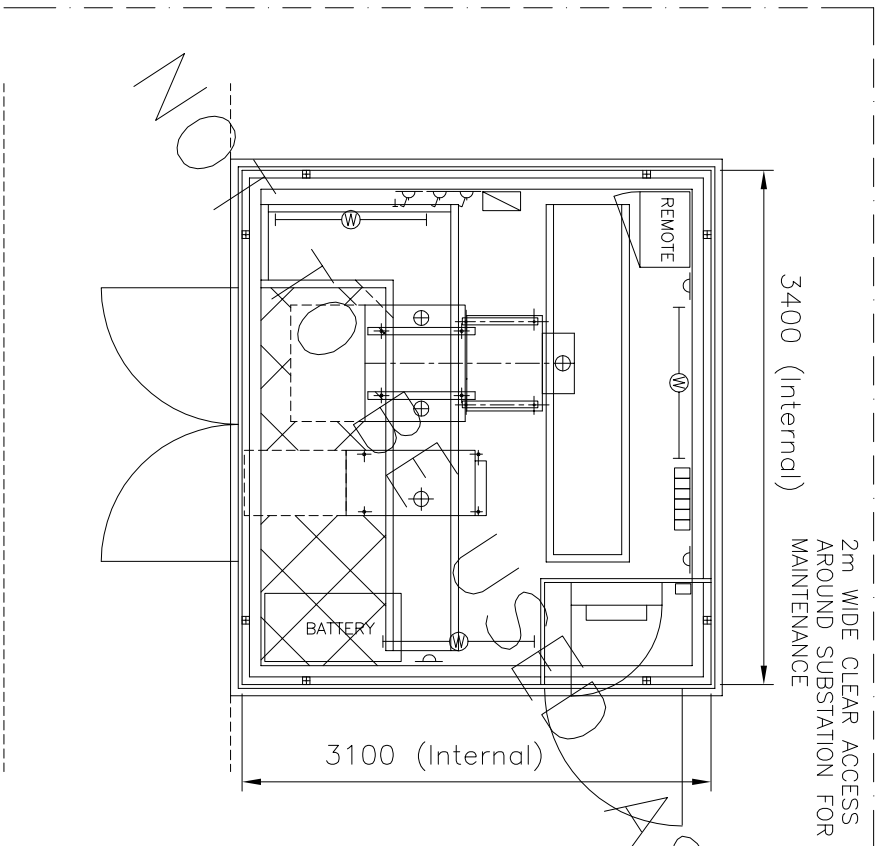

ELECTRICAL LAYOUT

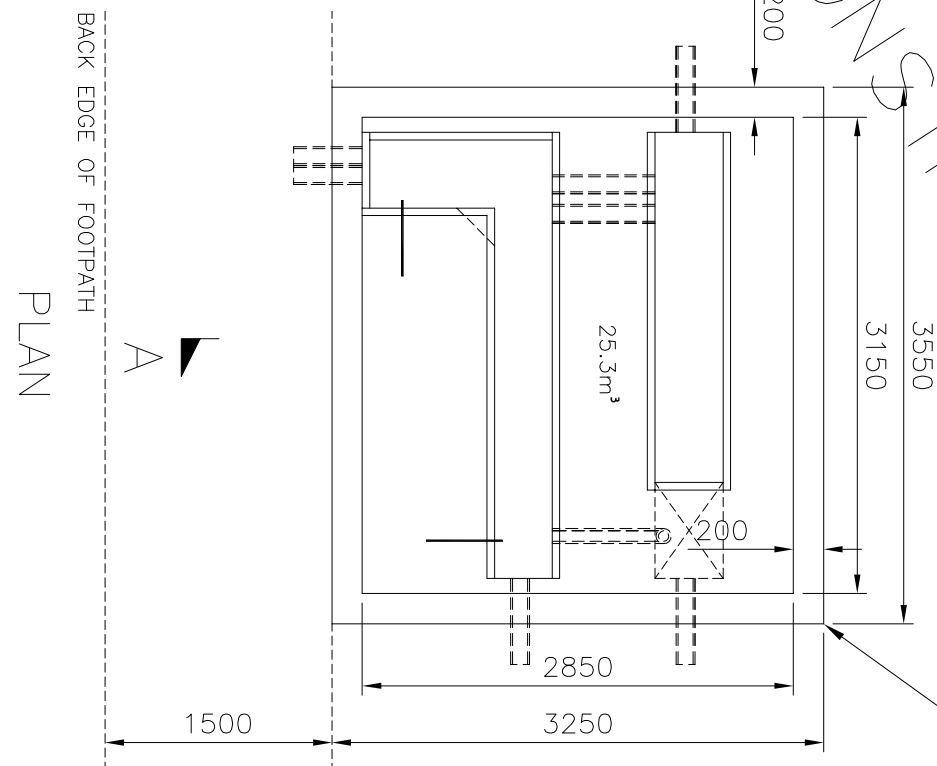

PLAN

NORTHERN POWERGRID		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		11kV RMMU WITH OPTIONAL EXTENSIBLE SWITCH IN PREFABRICATED ENCLOSURE	
Sheet No.	1	Scale	AS SHOWN
Prepared By	TM	Document Details	GENERAL ARRANGEMENT / PLAN & ELEVATIONS
Revised	Grid Reference	Ref No.	C993908
Date Issued	17.05.16	Checked By	JJ
		Revision	B
		Notes	