

SUBSTATION DOORS TO MEET SPECIFICATION WITH VENTILATION OPENINGS, IN 2590x2400mm HIGH BRICKWORK OPENING

FRONT ELEVATION

REAR ELEVATION


SIDE ELEVATION

50 x 200mm REBATE TO ACCEPT PREFABRICATED ENCLOSURES


SECTION A-A

NOTES

Substation doors to be set back a minimum of 1500mm from back edge of footpath. Any proposed reduction in this clearance to be approved by Northern Powergrid following submission of site specific risk assessment and operational method statement.

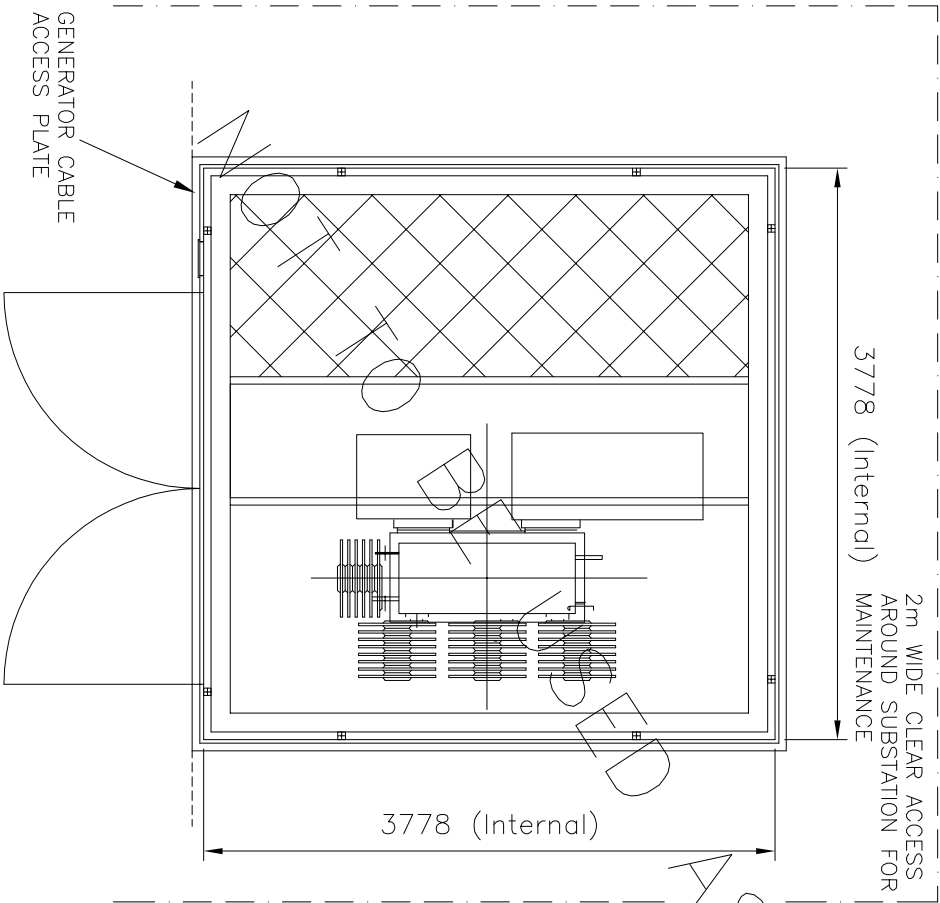

ELECTRICAL LAYOUT

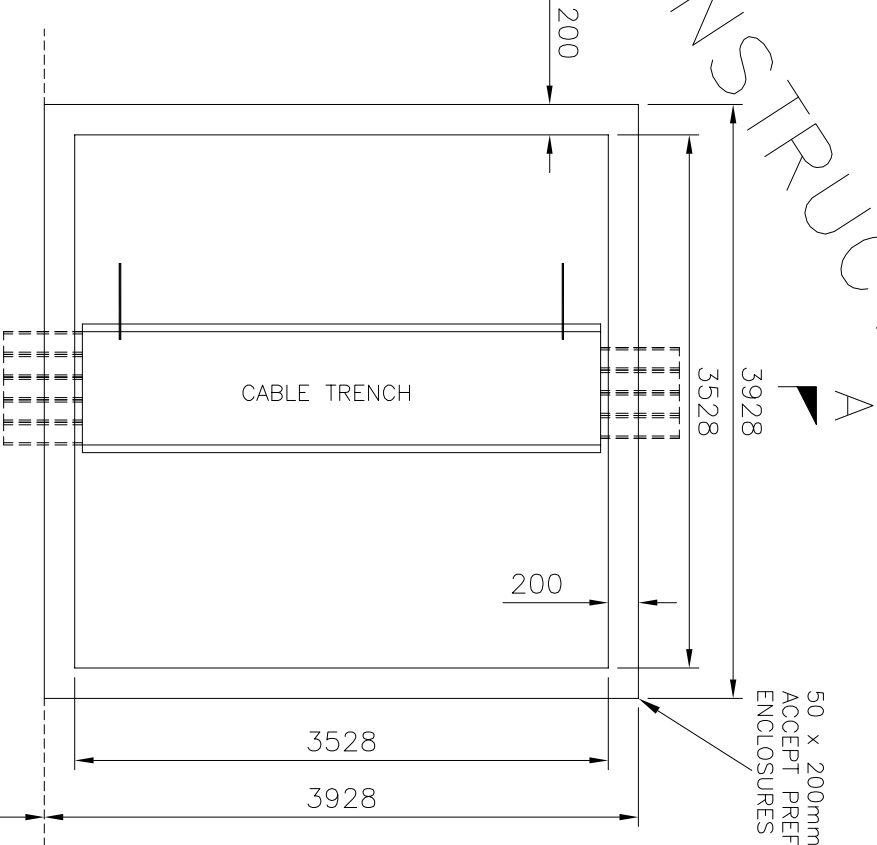

PLAN



Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

315 – 1000kVA SLIDE IN UDE IN PREFABRICATED ENCLOSURE

Manufacturer Details

Sheet No.

1

Scale

AS SHOWN

Prepared By

Revised

TM

Date Issued

17.05.16

Grid Reference

JJ

Ref No.

A

Revision

Notes

Document Details

GENERAL ARRANGEMENT / PLAN & ELEVATIONS

Historic Drawing No.

C1063405