


SW1 (LH) CABLE BOX

SW2 (RH) CABLE BOX

RMU

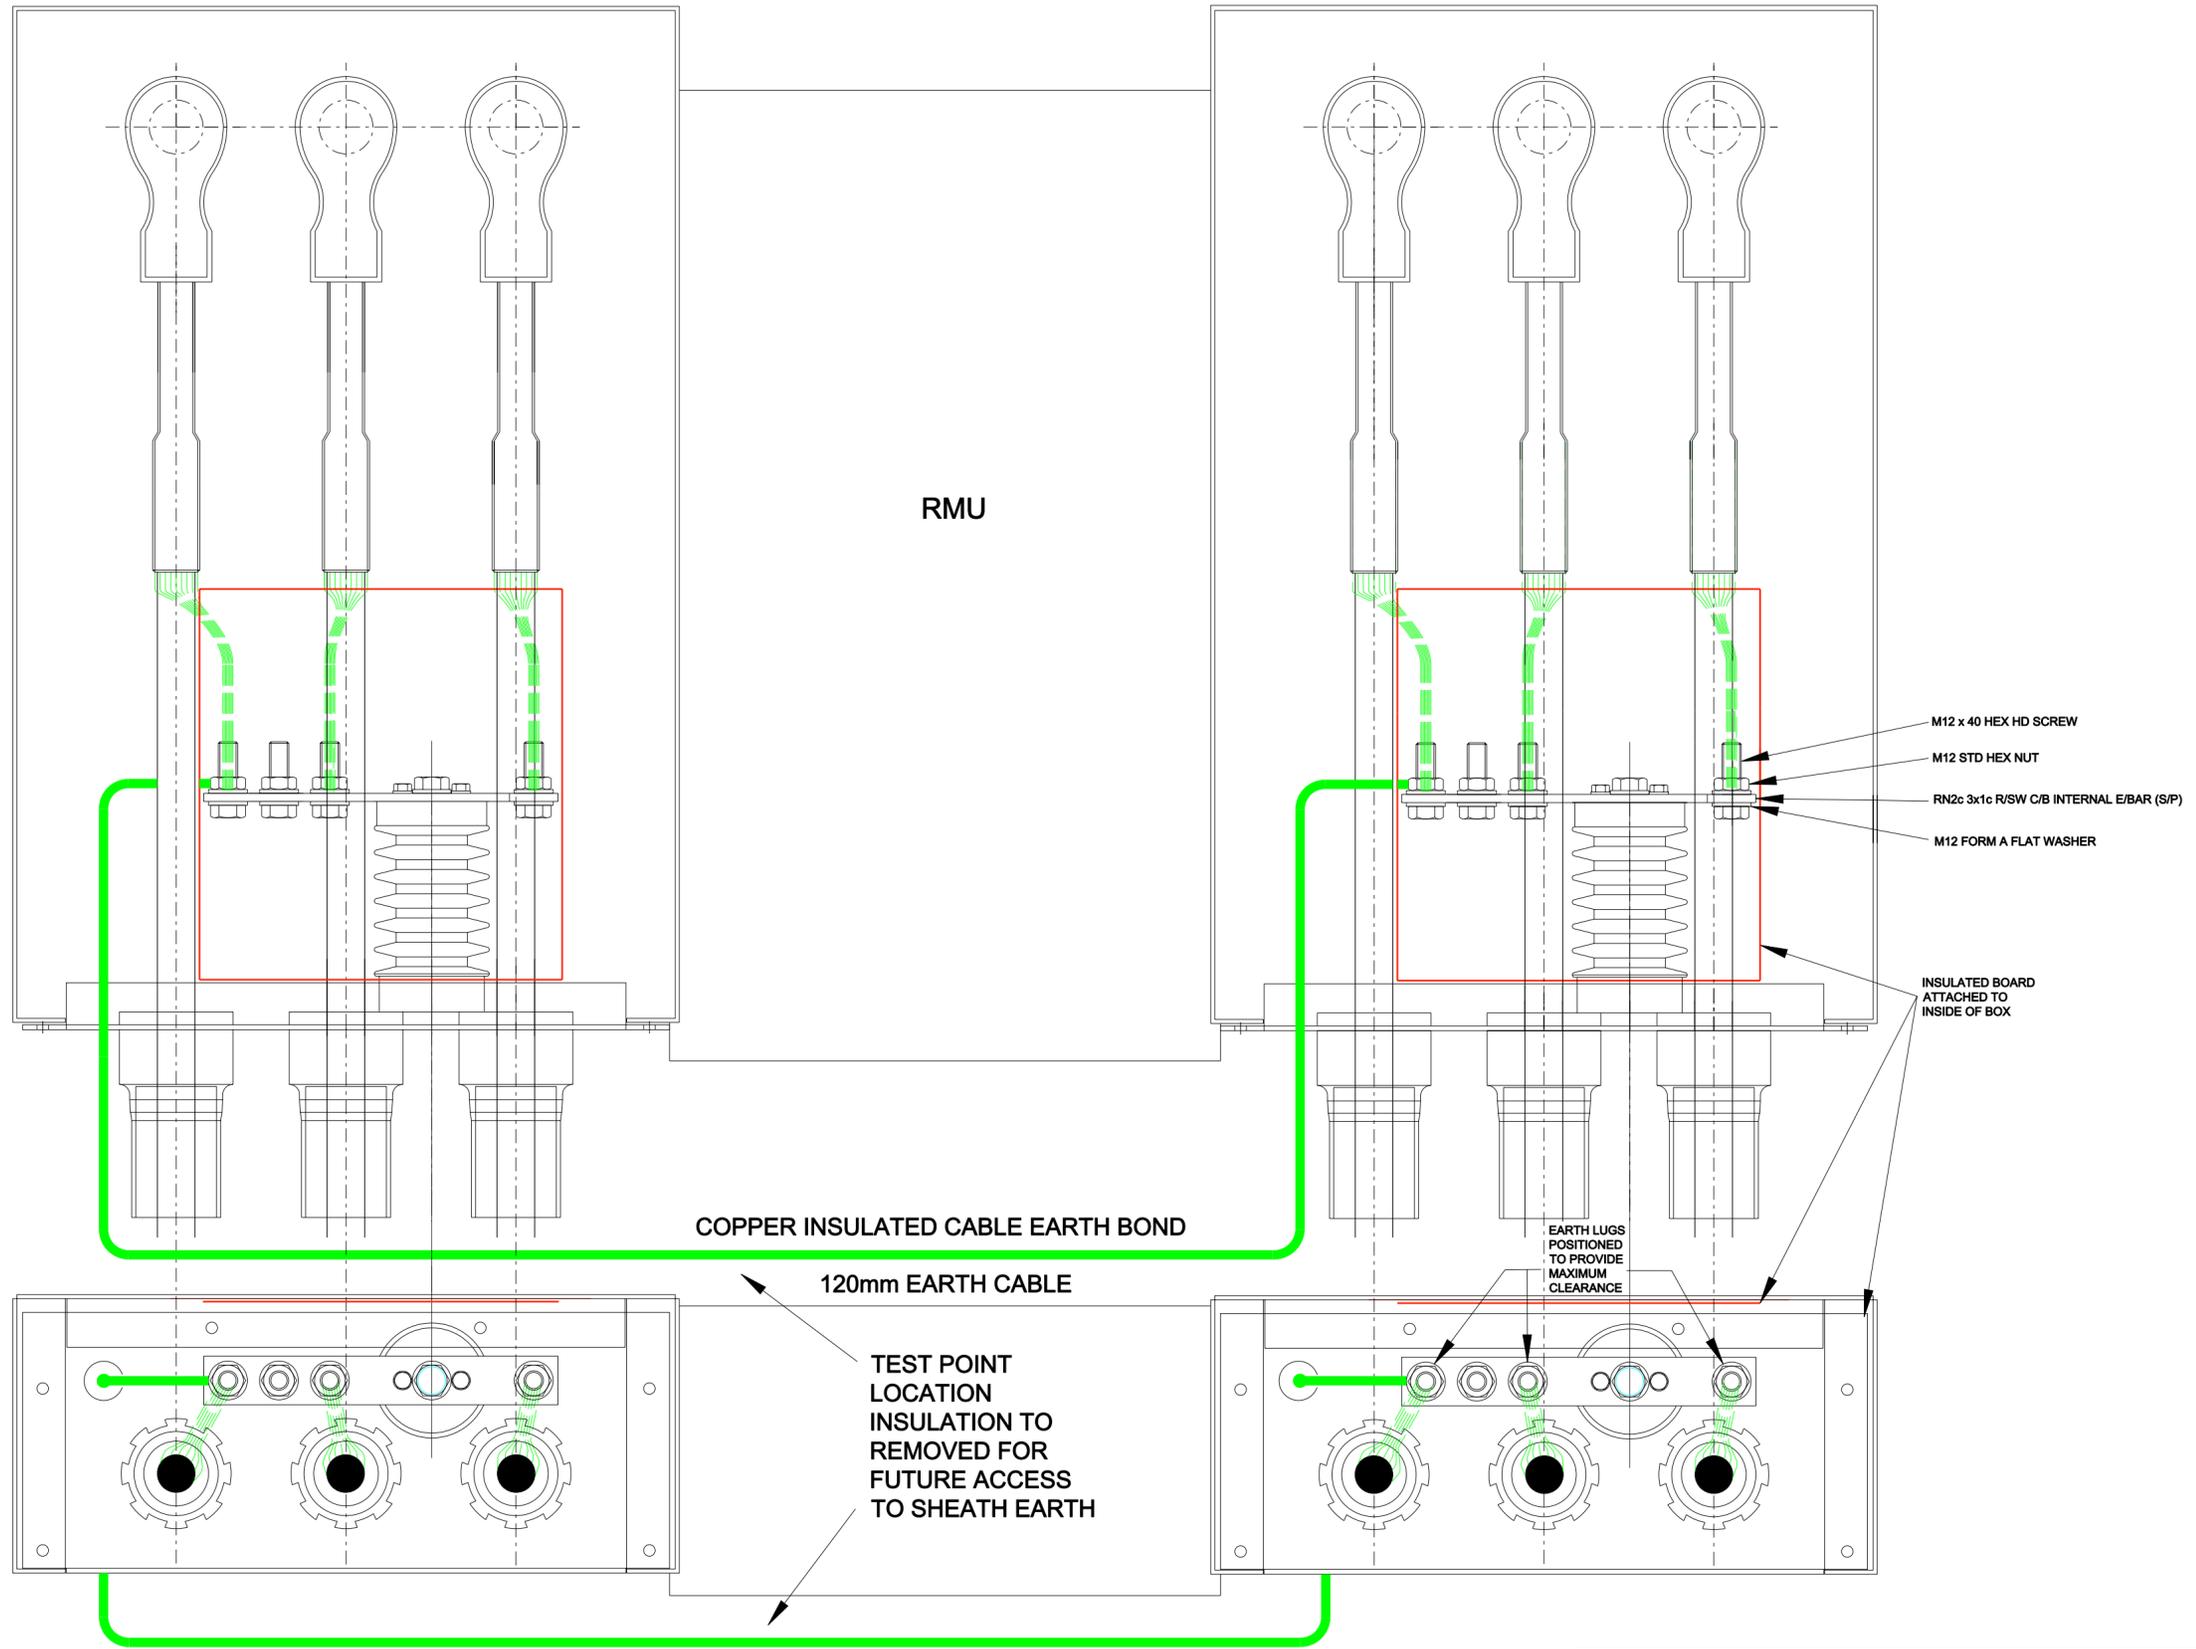

- M12 x 40 HEX HD SCREW
- M12 STD HEX NUT
- RN2c 3x1c R/SW C/B INTERNAL E/BAR (S/P)
- M12 FORM A FLAT WASHER

INSULATED BOARD ATTACHED TO INSIDE OF BOX

EARTH LUGS POSITIONED TO PROVIDE MAXIMUM CLEARANCE

COPPER INSULATED CABLE EARTH BOND

120mm EARTH CABLE

TEST POINT LOCATION INSULATION TO BE REMOVED FOR FUTURE ACCESS TO SHEATH EARTH

120mm EARTH CABLE

NOT TO SCALE

RN2c 3x1c RING C/BOX EARTHING KIT
 Schneider Electric Ltd, Leeds
 Bend Angle Rules
 All bend angles to be 90° ±0.5°
 (Except where stated)

NORTHERN POWERGRID

Manufacturer Details

Sheet No. _____ Scale N.T.S.

Prepared By Debbie Johnson

Modified 21/12/2016 Grid Reference _____

Created 27/09/2014 Checked by D POLLIN

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

RMU CABLE SHEATH BONDING

Document Details

OTHER PLANT EARTHING

Drawing No. C1040519 Historic Drawing No. 6031362

Revision D Notes COPPER INSULATED CABLE MODIFIED

ISO A2
C.A.D.