
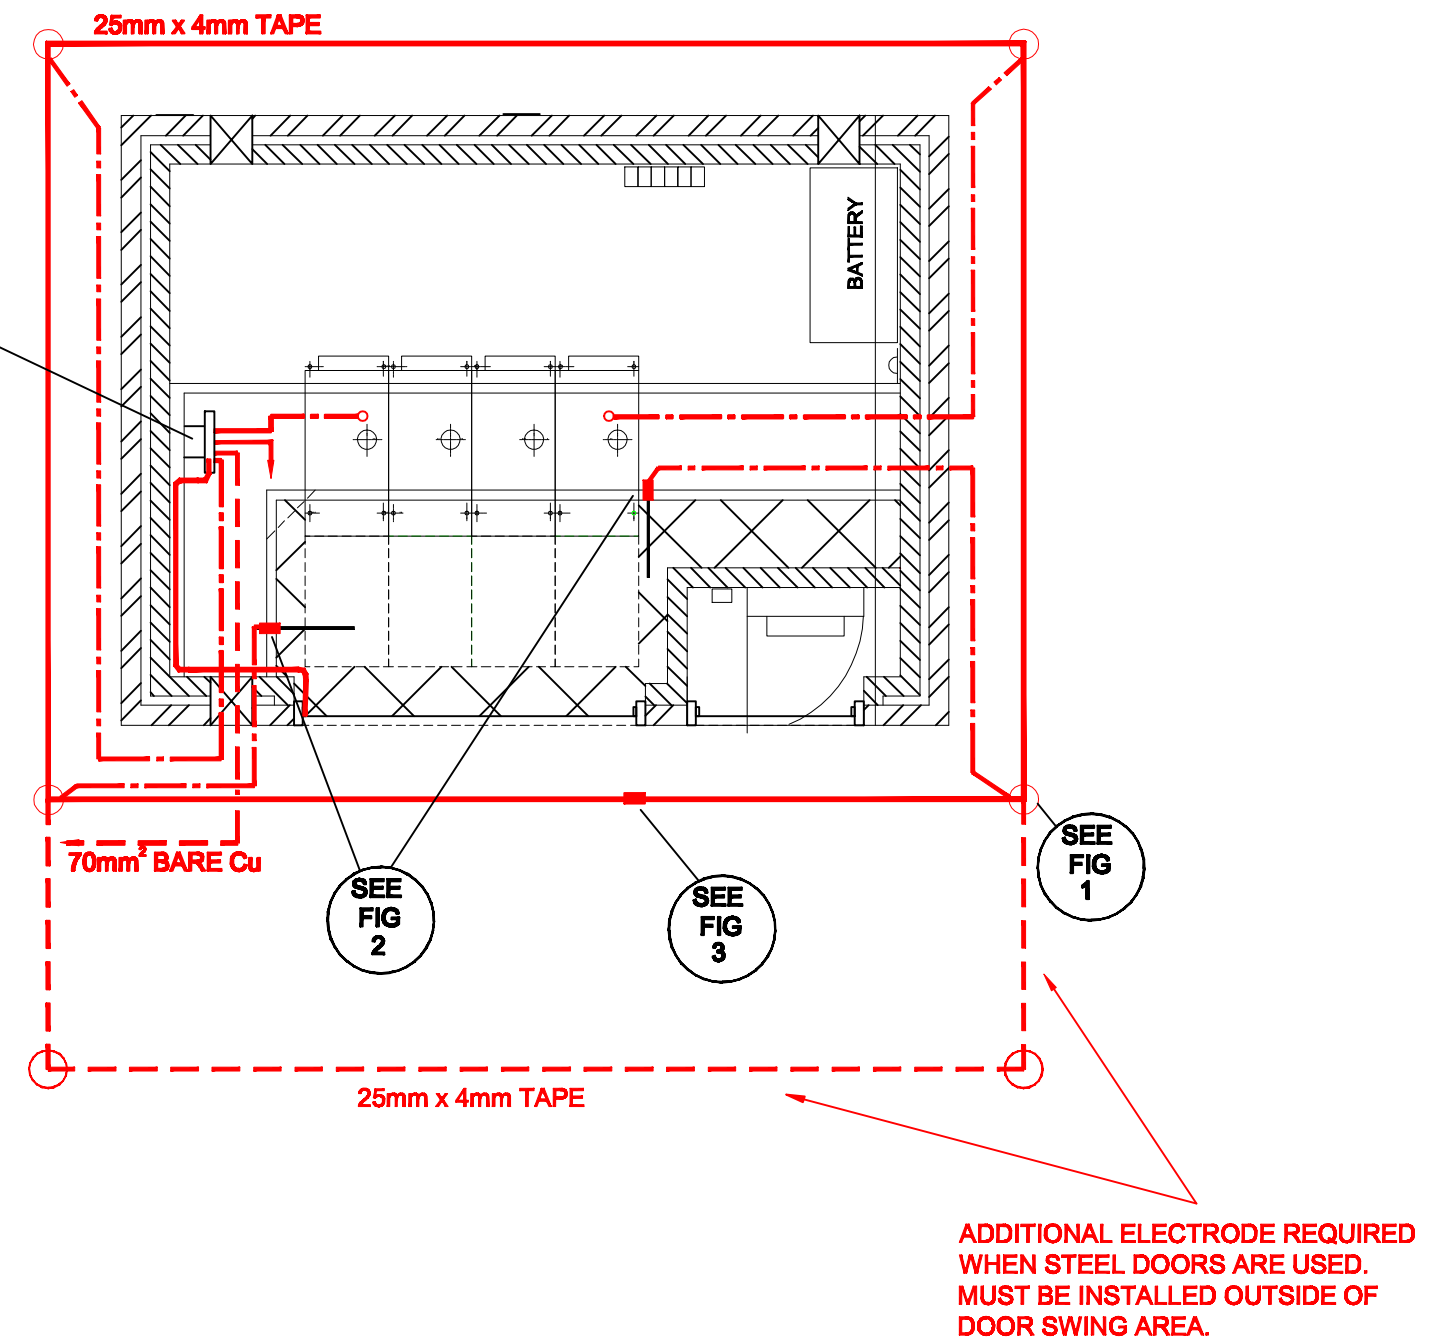


FIG. 5

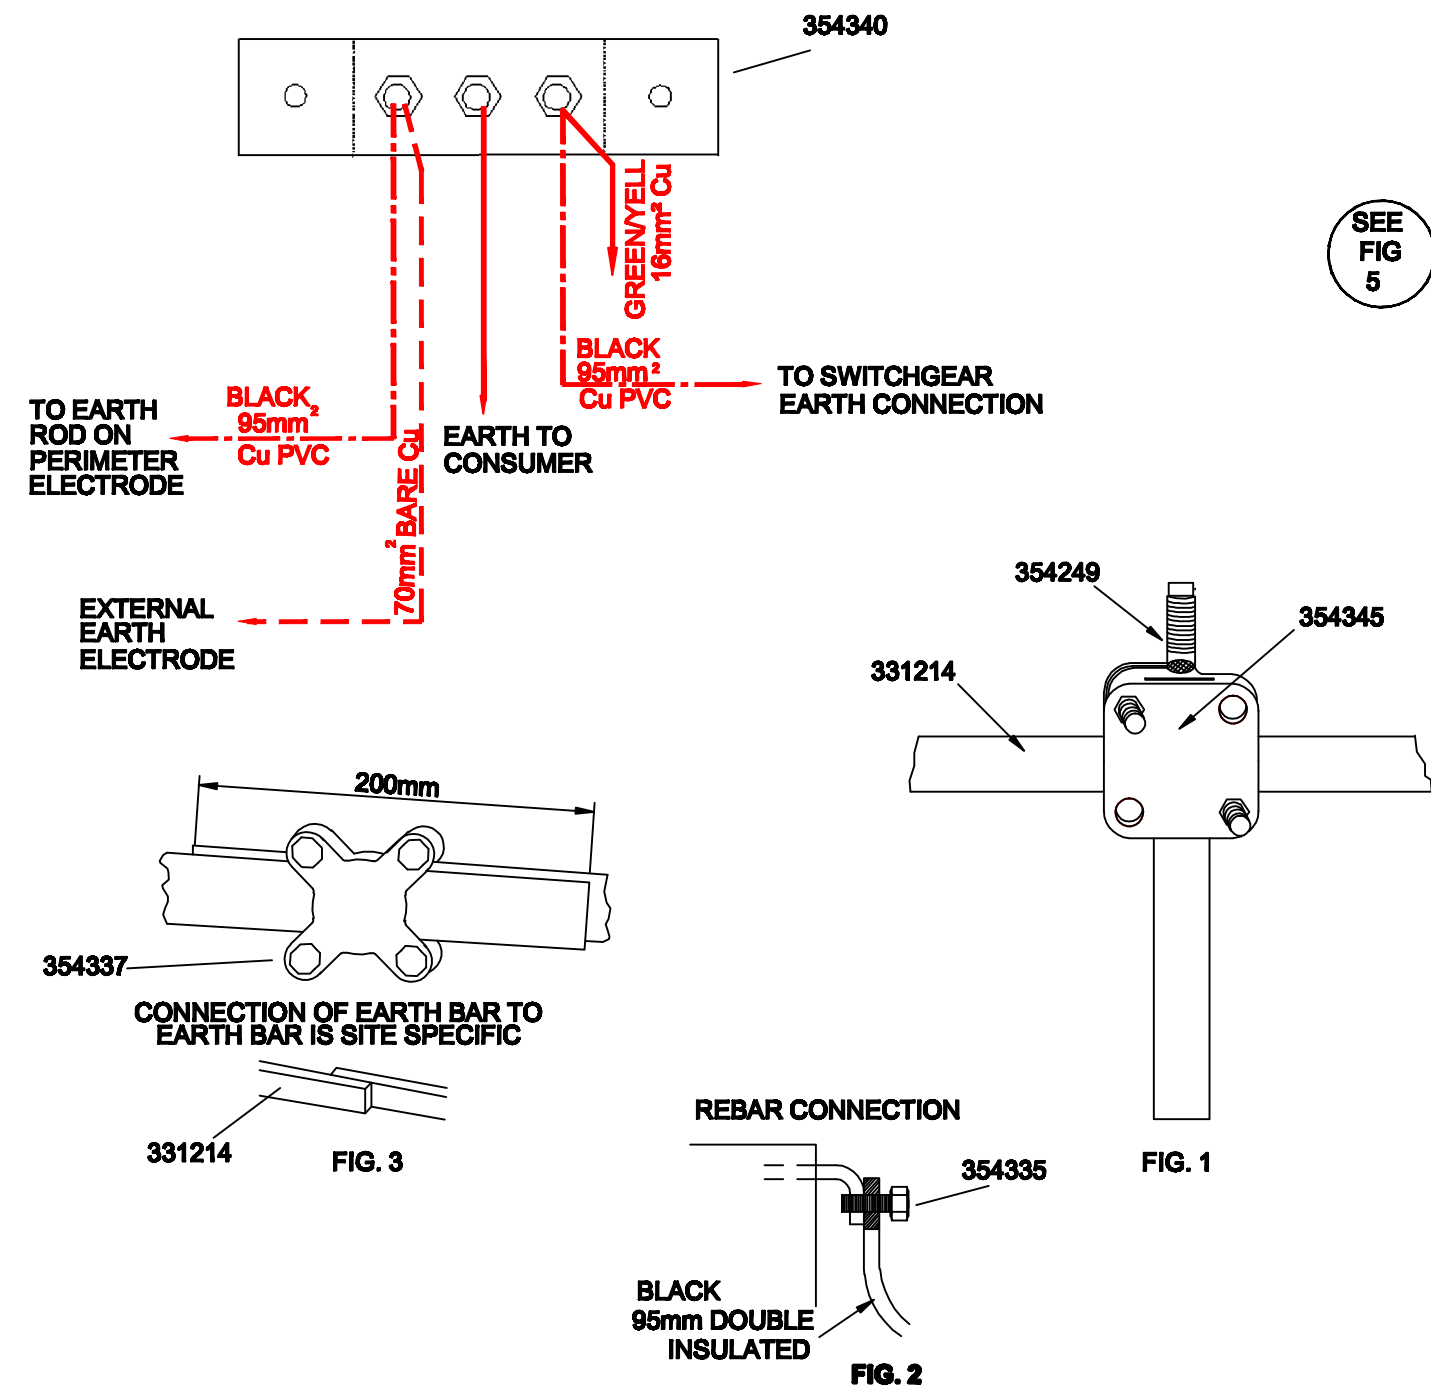


**COLD Site - (Combined Site)**

- The external earth electrode is to be laid for a minimum of 80M out with the incoming cables or length of the HV trench if less than 80M. (Conductor to be 70mm<sup>2</sup> CSA Bare Cu). **Note: To be installed on a COLD Site only.**
- Perimeter electrode to be installed in direct contact with the soil at a depth of 0.6M to 1.2M on the outer edge of the foundation. (25mm x 4mm Copper earth tape to be used with 'Property of Northern Powergrid' engraved on tape).
- Earth rods to be installed at a depth of 1.2M (2.4M in Rural Environments).
- Bonding from perimeter nest to switchgear, transformer, LV cabinet and rebar to be 95mm<sup>2</sup> Cu Black PVC covered conductor.
- Bonding from metal door frame to switchgear to be 16mm<sup>2</sup> Cu Green / Yellow PVC covered conductor.
- All external joints to be covered with denso mastic tape.
- Substations with metal doors will require additional perimeter earth electrode at the front of the substation, see additional layout on drawing.
- The maximum resistance value for the combined HV / LV earth electrode must be less than 20ohms.

Use this drawing in conjunction with Northern Powergrid policy – IMP/010/011 Code of Practice for Earthing LV Networks and HV Distribution Substations and supplementary drawing C978643 (Earth Point Connection Details).

For cold site substations that are integral to a building where a full perimeter electrode cannot be installed, the earthing should be installed to drawing C1065495.

Steel Kiosk Substations will require additional perimeter earth electrode; these will be considered on an individual basis.

 <b>NORTHERN POWERGRID</b>	Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details	11KV EXTENSIBLE HV PANEL WITH METERING ANNEXE EARTHING ARRANGEMENT-COMBINED SITE (COLD)	
Sheet No. 1	Scale N.T.S.	Type PLANT DIAGRAMS
Prepared By Barbara.Gordon	Grid Reference	WIRING
Revised 12/01/17	Date Issued 28/06/12	Ref No. C1010822
Checked By S CRAWFORD	Revision C	Notes
		Historic Drg.No. C1010822